

1 2 3 4 5 6

A

B

C





D

A




B

C

D

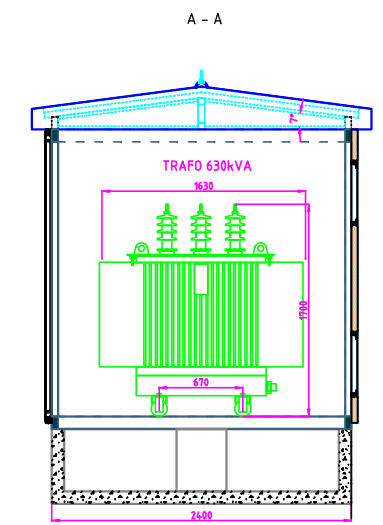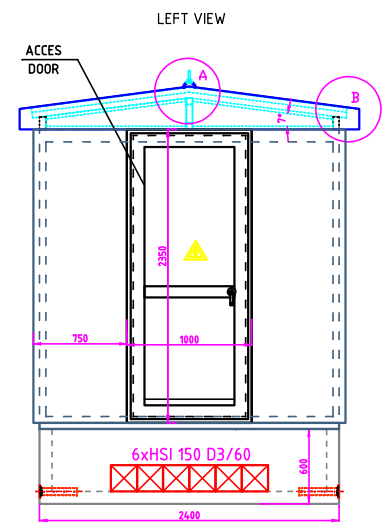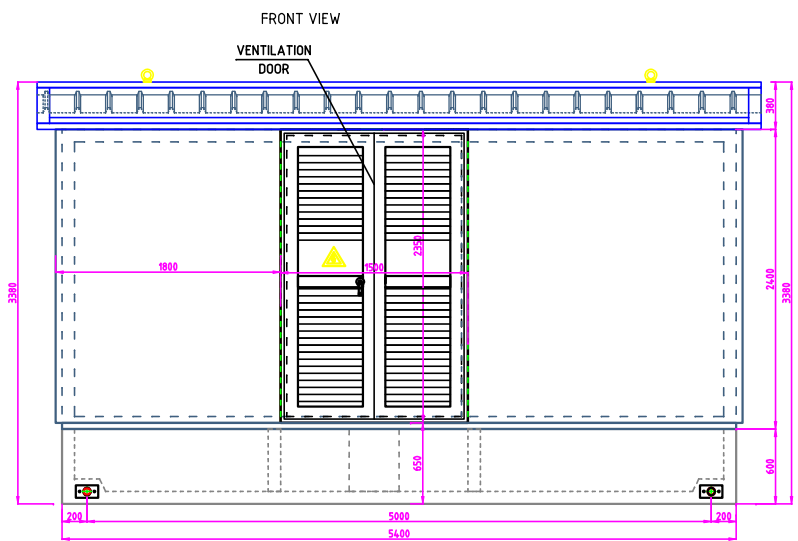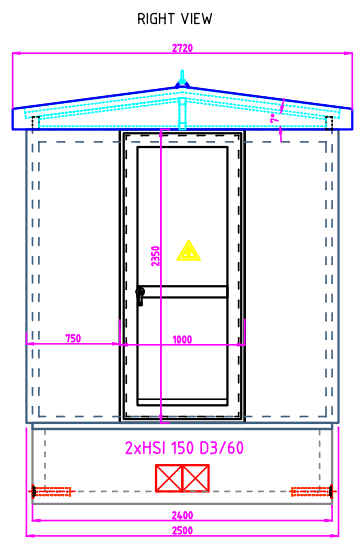

PLAN VIEW

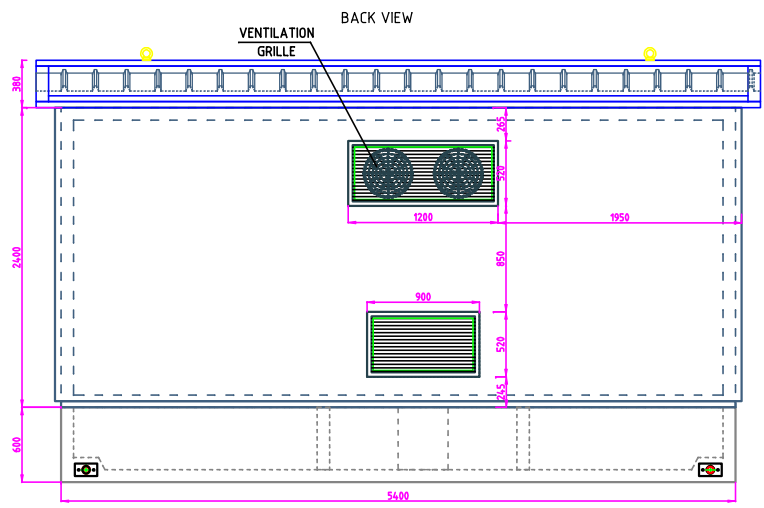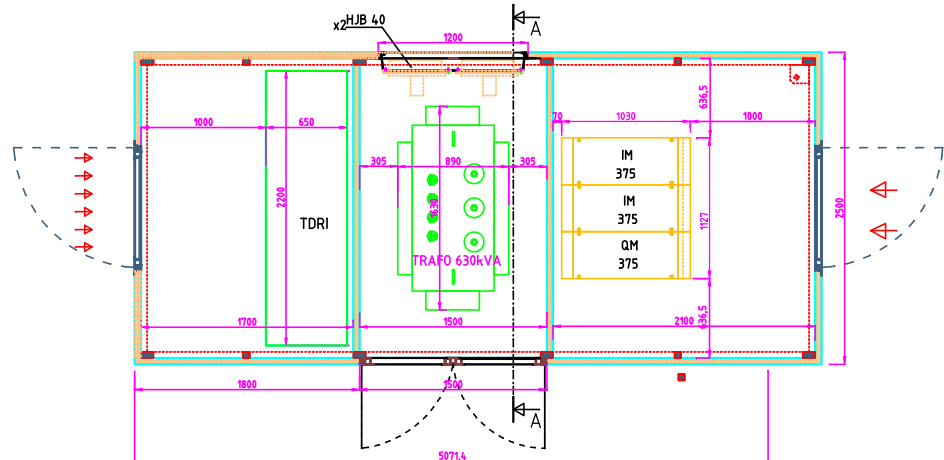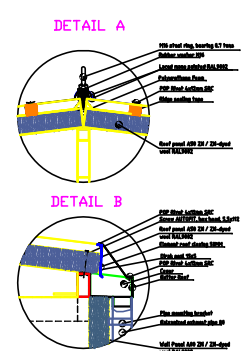

LEGENDA  
 HSI 150 D3/60

WARNING:  
 The underground water should be maximum 1meter closer to "0" level. Otherways a drain perimeter must be foreseen

Furnizor: SC ELECTROTEHNO SRL		Client:	
Oferta:		Contract :	
Produs: PTPA 1 (2) 630 KVA;10/0,4KV		Obiectiv:	
Cantitate: 1	Cod doc.:		Pl. 1/1
Nume doc.: Desen Cabina si Amplasare			
Proiectat:	Verificat: Radu Petru	Revizia:0	Data: 21.11.2016

1 2 3 4 5 6